



PLAN VIEW

NO SCALE

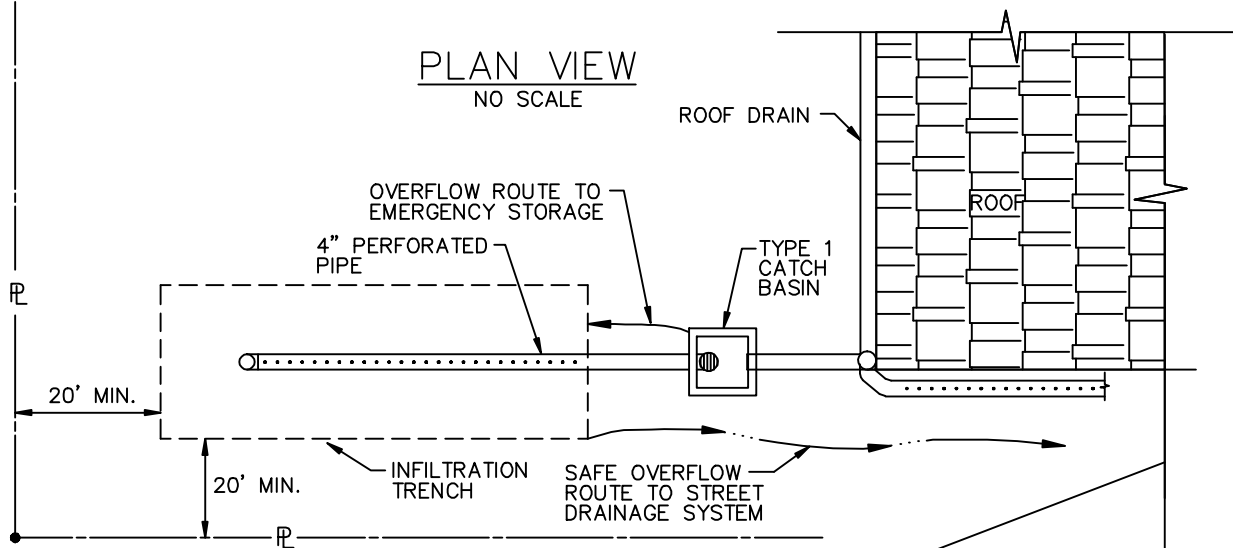


PROFILE VIEW

NO SCALE

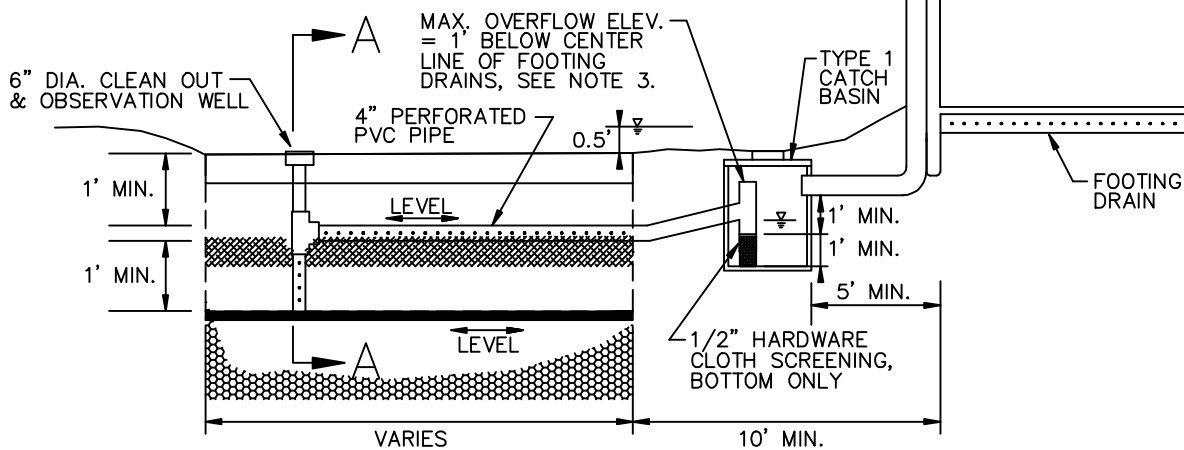

SECTION A-A

NO SCALE

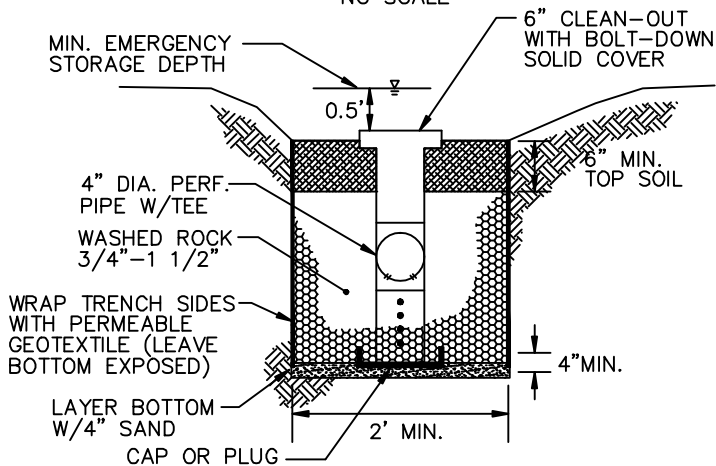

NOTES:

1. TRENCH SHALL NOT BE LOCATED WITHIN 30' OF A WELL OR ANY PART OF A SEPTIC SYSTEM.
2. IF MAX OVERFLOW ELEVATION CANNOT BE MET, THEN FOOTING DRAIN WILL REQUIRE A SEPERATE AND UPSLOPED FOOTING DRAIN.
3. IF LENGTH REQUIREMENT CANNOT BE MET, MUST BE PUMPED TO APPROVED DISCHARGE.



City of SURFACE AND SURFACE
Bellevue WATER UTILITY

TITLE

ROOF DOWNSPOUT
INFILTRATION TRENCH

JANUARY, 2010

NO. D-41